Autotrol Performa™Cv

Conditioner/Filter

Water Control System

Installation, Operation and Maintenance Manual

This s stem	n installed b	:

Table of Contents

1.0 Performa Cv S stem	
2.0 Performa Cv 962 Control	
3.0 Performa Cv Filter Valve and Controls, 962F, 962FTC, 942F 3.1 Programming and Application	
4.0 Performa Cv Performance Charts and Graphs	
5.0 Performa Cv Service and Troubleshooting 5.1 Historical Data 5.2 Preventative Maintenance 5.3 Removing the Valve Assemble for Servicing 5.4 Removing the Control 5.5 Identification of Control Valving 5.6 Valve Disc Principle of Operation 5.7 Performa Cv Conditioner Flo Diagrams 5.8 Performa Cv Filter Flo Diagrams 5.9 Troubleshooting	
6.0 Performa Cv Parts	

1.0 Performa Cv System

1.1 Specifications

1.1.1 Performa Cv Conditioner

Flow Rates (Valve Only) Service @ 15 psi (1.03 bar) Back ash (Conditioner) @ 25 psi (1.72 bar) drop Service Back ash Conditioner	
Control Configurations 962 Microprocessor Demand System and 962 Electronic Time Back ash Brine Slo rinse Fast rinse E ternal Brine Valve Required - Timed Fill	
Valve Connections/Dimensions Tank Thread Inlet/Outlet.	*

1.1.2 Performa Cv Filter Specifications

Flow Rates (Valve Only)	
Service @ 15 psi (1.03 bar) drop	25.0 gpm (5.7 m ³ /h)
Back ash (Filter) @ 25 psi (1.72 bar) drop	25.0 gpm (4.5 m ³ /h)
Service	Cv = 6.5 (Kv = 5.58)
Back ash Filter	Cv = 5.0 (Kv = 5.78)
Control Operation	
942F Mechanical Clock Timer - 7 Day or 12 Day	
Back ash	
Fi ed Fast Rinse	9 minutes
962F Microprocessor Demand	
Back ash	
Fast Rinse	2 to 19 minutes
962 FTC Electronic Time Clock	4 to 60 minutos
Back ashFast Rinse	
Interval Regeneration	
interval negeneration	e week negeneration
Valve Connections/Dimensions	
Tank Thread	2-1/2 inches - 8. male
Inlet/Outlet	
Drain Line	. 3/4-inch NPT, male
Brine Line	
Distributor Tube O.D.	1 050 inches (27 mm)
	1.000 11101103 (27 111111)
Distributor Tube Length	
Distributor Tube Length	nm) above top of tank
Operating, Valve Bod ⁷ Distributor Tube Length	nm) above top of tankGlass-filled Plastic
Operating Valve Bod Rubber Components 1/2 1/2 inches (13 mm 13 nm	nm) above top of tankGlass-filled Plastic bunded for cold ater
Operating Valve Bod Rubber Components Weight (Valve ith Control)	Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg)
Distributor Tube Length	Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg)
Operating Valve Bod Rubber Components Weight (Valve ith Control)	Glass-filled Plastic bunded for cold ater 4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) OO H , 230V 50/60 H
Distributor Tube Length	Glass-filled Plastic bunded for cold ater 4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H
Distributor Tube Length	Glass-filled Plastic bunded for cold ater 4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar)
Distributor Tube Length	Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 60 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar)
Distributor Tube Length	Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 60 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar)
Distributor Tube Length	Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 60 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar)
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C)
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C)
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) OH , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C)
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C) s - 12 UNC - 2A male -inch, 28-mm, 22-mm
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) OH , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C) s - 12 UNC - 2A male -inch, 28-mm, 22-mm inch, 3/4-inch, 25-mm
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C) s - 12 UNC - 2A male -inch, 28-mm, 22-mm inch, 3/4-inch, 25-mm h male, 3/4-inch male
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) 50 H , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C) s - 12 UNC - 2A male -inch, 28-mm, 22-mm inch, 3/4-inch, 25-mm h male, 3/4-inch male
Distributor Tube Length	nm) above top of tank Glass-filled Plastic bunded for cold ater4.5 lbs (2.0 kg) VAC 400 mA (4.6 vA) OH , 230V 50/60 H 100V 50/60 H psi (1.37 to 8.27 bar) psi (1.37 to 6.89 bar) to 100°F (1° to 38°C) s - 12 UNC - 2A male -inch, 28-mm, 22-mm inch, 3/4-inch, 25-mm h male, 3/4-inch male h male, 3/4-inch male

See Section 4.1 for specification dra ings.

1.2 Installation

All plumbing and electrical connections must conform to local codes.

Inspect unit carefull, for carrier shortage or shipping damage.

Location Selection

- 1. The distance bet een the unit and a drain should be as short as possible.
- 2. If it is likely that supplementary ater treatment equipment ill be required, make certain adequate additional space is available.
- 3. Since salt must be added periodicall to the brine tank, the location should be easil accessible.
- 4. Do not install an unit closer to a ater heater than a total run of 10 feet (3 m) of piping bet een the outlet of the conditioner and the inlet to the heater. Water heaters can sometimes overheat to the e tent the ill transmit heat back do n the cold pipe into the unit control valve.
 - Hot ater can severely damage the conditioner. A 10-foot (3-m) total pipe run, including bends, elbo s, etc., is a reasonable distance to help prevent this possibility. A positive ay to prevent hot ater flo ing from heat source to the conditioner, in the event of a negative pressure situation, is to install a check valve in the soft ater piping from the conditioner. If a check valve is installed, make certain the water heating unit is equipped with a properly rated temperature and pressure safety relief valve. Also, be certain that local codes are not violated.
- Do not locate unit here it or its connections (including the drain and overflo lines) ill ever be subjected to room temperatures under 34°F (1°C) or over 120°F (49°C).
- 6. Do not install unit near acid or acid fumes.
- 7. The use of resin cleaners in an unvented enclosure is not recommended.

Water Line Connection

The installation of a b pass valve s stem is recommended to provide for occasions hen the ater conditioner must be b passed for hard ater or for servicing.

The most common b⁷ pass s⁷ stems are the Autotrol Series 1265 b⁷ pass valve (Figure 1.1) and plumbed-in globe valves (Figure 1.2). Though both are similar in function, the Autotrol Series 1265 b⁷ pass offers simplicit⁷ and ease of operation.

Not in Bypass

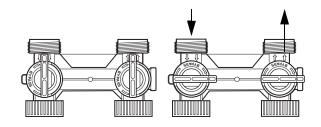


Figure 1.1 - Autotrol Series 1265 B⁷ pass Valve

Figure 1.2 - T pical Globe Valve B pass S stem


Drain Line Connection

Note: Standard commercial practices are e pressed here. Local codes ma⁷ require changes to the follo ing suggestions.

- 1. Ideall located, the unit ill be above and not more than 20 feet (6.1 m) from the drain. For such installations, using an appropriate adapter fitting, connect 1/2-inch (1.3-cm) plastic tubing to the drain line connection of the control valve.
- If the back ash flo rate e ceeds 5 gpm (22.7 Lpm) or if the unit is located more than 20 feet (6.1 m) from drain, use 3/4-inch (1.9-cm) tubing for runs up to 40 feet (12.2 m). Also, purchase appropriate fitting to connect the 3/4-inch tubing to the 3/4-inch NPT drain connection.
- 3. If the unit is located here the drain line must be elevated, ou mar elevate the line up to 6 feet (1.8 m) providing the run does not e ceed 15 feet (4.6 m) and ater pressure at conditioner is not less than 40 psi (2.76 bar). You mar elevate an additional 2 feet (61 cm) for each additional 10 psi (0.69 bar).

- 4. Where the drain line is elevated but empties into a drain belo the level of the control valve, form a 7-inch (18-cm) loop at the far end of the line so that the bottom of the loop is level ith the drain line connection. This ill provide an adequate siphon trap.
- 5. Where the drain empties into an overhead se er line, a sink-t/ pe trap must be used.

IMPORTANT: Never insert drain line into a drain, se er line or trap. Al a's allo an air gap bet een the drain line and the aste ater to prevent the possibility of se age being back-siphoned into the conditioner.



Note: Standard commercial practices have been e pressed here. Local codes may require changes to these suggestions.

Brine Line Connection

It ill be necessar, to install the brine line for a Performa Cv conditioner to the brine fitting on the valve (3/8-inch NPT).

Be sure all fittings and connections are tight.

Overflow Line Connection

In the absence of a safet overflo and in the event of a malfunction, the BRINE TANK OVERFLOW ill direct overflo to the drain instead of spilling on the floor here it could cause considerable damage. This fitting should be on the side of the cabinet or brine tank.

To connect overflo , locate hole on side of brine tank. Insert overflo fitting (not supplied) into tank and tighten ith plastic thumb nut and gasket as sho n (Figure 1.4). Attach length of 1/2-inch (1.3-cm) I.D. tubing (not supplied) to fitting and run to drain. Do not elevate overflo line higher than 3 inches (7.6 cm) belo bottom of overflo fitting. Do not tie into drain line of control unit. Overflo line must be a direct, separate line from overflo fitting to drain, se er or tub. Allo an air gap as per drain line instructions (Figure 1.3).

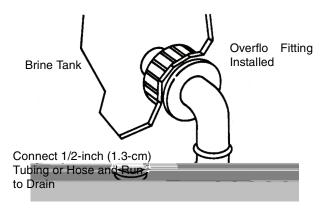


Figure 1.4

Battery Back-Up

All 962 famil controls are batter backup capable. A 9-volt rechargeable batter is available from Osmonics, P/N 1075768. The batter is a VARTA, TYPE V7/8H (AccuPlus Nickle H dride Ni-mh 9v 150 mAH, No. 5522). A standard non-rechargeable batter is an option for backup but needs to be replaced periodicall, Figure 1.5.

Figure 1.5

1.3 Placing Performa Cv Conditioner/Filter into Operation

After all previous steps have been completed, the unit is read to be placed into operation. Follo these steps carefull.

 Remove control valve cover b first depressing the plastic clips from the front of the cover. Pull front of cover up.

Note: The follo ing steps ill require turning the c' cle indicator to various positions. Manually rotate the camshaft COUNTERCLOCKWISE only until c' cle indicator points to desired position. (See manual regeneration sections for each control's manual operation.)

- 2. Rotate c⁷ cle indicator **COUNTERCLOCKWISE** until it points directl to the ord **BACKWASH**.
- 3. Fill media tank ith , ater.
 - a. With ater supply off, place the by pass valve(s) into the service position.
 - b. Open ater supply valve very slo ly to appro imately the 1/4 open position.

IMPORTANT: If opened too rapidl¹ or too far, media ma¹ be lost. In the 1/4 open position, ¹ ou should hear air escaping slo 1¹ from the drain line.

Conditioner

- a. When all of the air has been purged from the tank (ater begins to flo steadil from the / drain), open the main suppl valve all the a'.
- b. Allo ater to run to, drain until clear.
- c. Turn off ater suppl¹ and let the unit stand for about five minutes. This ill allo all trapped air to escape from the tank.
- 4. Add ater to brine tank (initial fill).
 With a bucket or hose, add appro imately
 4 gallons (15 liters) of ater to brine tank. If the tank has a salt platform above the bottom of the tank, add ater until the level is appro imately
 1 inch (25 mm) above the platform.
- 5. Place the conditioner into operation.
 - a. With the ater supply valve completely open, carefully advance the cocle indicator COUNTERCLOCKWISE to the center of the BRINE REFILL position. Hold at this position until ater starts to flo through the brine line into the brine tank. Do not run for more than to minutes.
 - Advance the c¹ cle indicator
 COUNTERCLOCKWISE until it points to the center of the BRINE/SLOW RINSE position.

- c. With the conditioner in this position, check to see if ater is being dra n from the brine tank. The vater level in the brine tank ill recede very slo li. Observe ater level for at least three minutes. If the ater level does not recede, or if it goes up, reference the **Troubleshooting** section.
- d. Advance the c⁷ cle indicator **COUNTERCLOCKWISE** to the **REGENERATION COMPLETE** position and run

 ater from a nearb⁷ faucet until the ater is

 clear and soft.

Filter

All filter medias e cept carbon:

- a. After the air has been purged from the tank (ater begins to flo /steadil/from the drain) open the main suppl/all the a/. Back ash media for/a minimum of 15 minutes or longer if necessar/. Water running to the drain should be clear.
 - Carbon media should be allo ed to soak for a minimum of 12 hours to allo air bubbles to escape prior to back ashing.
- After the back ash is complete plug in control and allo it to advance to BACKWASH COMPLETE.

Electrical Connection

100 VAC, 115 VAC, and 230 VAC units: Remove t ist tie from the po er cord and e tend cord to its full length. Make sure po er source matches the rating printed on the control. Be certain a all s itch does not control the outlet.

12 VAC: Connect the plug of the transformer (supplied) secondar cable to the mating socket at the rear or bottom of the timer housing. Be certain the transformer is secure and is plugged into a/po er source of correct voltage that is not controlled b' a all s itch.

1.4 Disinfection of Water Conditioners

The materials of construction of the modern ater conditioner ill not support bacterial gro th, nor ill these materials contaminate a ater supply. Ho ever, the normal conditions e isting during shipping, storage and installation indicate the advisability of disinfecting a conditioner after installation, before the conditioner is used to treat potable pater. In addition, during normal use, a conditioner may become fouled ith organic matter or in some cases ith bacteria from the ater supply.

Thus ever conditioner should be disinfected after installation, some ill require periodic disinfection during their normal life, and in a fe cases disinfection ith ever regeneration ould be recommended.

Depending upon, the conditions of use, the st, le of conditioner, the t pe of ion e changer, and the disinfectant available, a choice can be made among the follo ing methods.

Sodium or Calcium Hypochlorite

Application

These materials are satisfactor for use ith polist rene resins, s nthetic geleolite, greensand and bentonites.

5.25% Sodium Hypochlorite

These solutions are available under trade names such as Cloro Bleach*. If stronger solutions are used, such as those sold for commercial laundries, adjust the dosage accordingly.

1. Dosage

- a. Pol st rene resin: 1.2 fluid ounces per cubic foot.
- Non-resinous e changers: 0.8 fluid ounce per cubic foot.

2. Brine tank conditioners

- a. Back ash the conditioner and add the required amount of h' pochlorite solution to the brine ell of the brine tank. (The brine tank should have ater in it to permit the solution to be carried into the conditioner.)
- b. Proceed ith the normal regeneration.

Calcium Hypochlorite

Calcium h¹ pochlorite, 70% available chlorine, is available in several forms including tablets and granules. These solid materials ma¹ be used directly ithout dissolving before use.

- 1. Dosage
 - a. T o grains (appro imatel 0.1 ounce) per cubic foot.

2. Brine tank conditioners

- a. Back ash the conditioner and add the required amount of h pochlorite to the brine ell of the brine tank. (The brine tank should have ater in it to permit the chlorine solution to be carried into the conditioner.)
- b. Proceed ith the normal regeneration.

^{*}Cloro Bleach is a trademark of the Cloro Compan,

2.2 Programming and Application

This section covers all aspects of programming the 962 control.

Note that some parameters have a single unit of measure option such as the Rinse Time hich is only entered in minutes. Other parameters have dual units such as Salt Amount hich can be entered in pounds or kilograms. To select hich units are active, look for a comment in the NOTES column of Table 2.1 and Table 2.4. It ill reference another parameter that selects hich units are active. For e ample, Parameter P12 (Table 2.4) selects U.S. units if it is set to "0" and metric if it is set to "1."

Level I Parameters (Table 2.1)

Level I Parameters are identified as those that have an LED indicator on the front panel. The green indicator illuminates ne t to the name of the active control setting. The end user has access to all of these parameters. In general, pressing the **DOWN ARROW** (\downarrow) button displars the Level I Parameters in the follosing order:

Time of Da⁷
Time of Regeneration
Hardness
Salt Ampunt
Capacit⁷

If \vec{l} ou continue to press the **DOWN ARROW** (\downarrow) button, the parameters start over ith Time of Da \vec{l} . Pressing the **UP ARROW** (\uparrow) button displa \vec{l} s the parameters in reverse order. Refer to Table 2.1 for a description of these parameters and the available ranges for each parameter.

Press the **SET** button and the far right number on the displar starts flashing. If \overrightarrow{l} ou ant to change this number, press the **UP ARROW** (\uparrow) button to increase the number or the **DOWN ARROW** (\downarrow) button to decrease the number. To skip the number ithout changing, press the **LEFT ARROW** (\leftarrow) button. When \overrightarrow{l} ou reach the far left digit, pressing the **LEFT ARROW** (\leftarrow) button ill return \overrightarrow{l} ou to the far right digit.

Note: If $^{\downarrow}$ ou press and hold either the **UP ARROW** ($^{\uparrow}$) button or the **DOWN ARROW** ($^{\downarrow}$) button for more than one second, the flashing number ill increment or decrement at the rate of 10 counts per second.

When the number is correct, press the **LEFT ARROW** (←) button. The first number stops flashing and the net number starts flashing. You can only change the flashing number. Continue changing numbers until you reach the desired setting. Press the **SET** button. The numbers stop flashing and the control accepts the nesetting. After approximately 30 seconds, the control starts alternating the display bet een Time of Day and Capacity.

Note: If a beep sounds, the ne setting is not accepted because it as outside the allo able range. The old value ill be displared.

Day of Week/Time of Day

Press the **SET** button. The displarimile, show the Time of Darimith the minutes digit blinking. If \downarrow ou and to change this number, press the **UP ARROW** (\uparrow) button to increase the number or the **DOWN ARROW** (\downarrow) button to decrease the number. To skip the number ithout changing, press the **LEFT ARROW** (\leftarrow) button.

Salt Amount

Salt Amount is the ne t value displaded. The default value for Salt Amount is 6 pounds (2.7 kilograms) of salt; refer to Table 2.2 for suggested salt settings.

Note: This is the total amount of salt used for a regeneration, not pounds per cubic foot. If 6 pounds is not acceptable, press the **SET** button and change the numbers. If 6 pounds is acceptable, press the **DOWN ARROW** (\downarrow) button.

Capacity

Capacit is the ne t value displared and is e pressed in kilograins (kilograms). Refer to Table 2.2 for the

Table 2.2 - Suggested Settings for P4, P5, P6, P7

P5 Capacity Setting	Resin Volume per Tank (liters)								
Kilograins (Kilograms)	3 ft ³ (85)	4 ft ³ (113)	5 ft ³ (142)	6 ft ³ (170)	7 ft ³ (198)				
	P4 Salt Setting: Pounds (kg) of Salt								
60 (3.9)	18 (8.2)	-	-	-	-				
80 (5.2)	-	24 (10.9)	-	-	-				
84 (5.4)	30 (13.6)	-	-	-	-				
90 (5.8)	45 (20.4)	-	-	-	-				
100 (6.4)	-	-	30 (27.2)	-	-				
112 (7.2)	-	40 (18.1)	-	-	-				
120 (7.7)	-	60 (27.2)	-	36 (16.3)	-				
140 (9.0)	-	-	50 (22.7)	-	42 (19)				
150 (9.7)	-	-	75 (34)	-	-				
168 (10.8)	-	-	-	60 (27.2)	-				
180 (11.6)	-	-	-	90 (40.8)	-				
196 (12.7)	-	-	-	-	70 (31.8)				
210 (13.6)	-	-	-	-	105 (47.6)				

P6 Refill Setting: 14 inch tank = 74 (.74 gpm) 16 inch thru 21 inch tanks = 130 (1.39 gpm)

P7 Brine Draw Setting. All values are based on 50 psi (3.5 bar) inlet pressure. For pressure other than 50 psi refer to brine dra charts in Section 4.0.

Tank Diameter	Injector	Part Number	P7 equals	Color	
14 in (35.5 cm)	М	1055737	60	Bro n	
16 in (40.6 cm)	Q	1035739	80	Purple	
18 in (45.7 cm)	Q	1035739	80	Purple	
21 in (53.3 cm)	R	1035884	83	Dark Gre	

Level II Parameters (Table 2.4)

The Level II Parameters are P6 through P22 in Table 2.4. To access Level II Parameters, simultaneousl press and hold the **DOWN ARROW** (↓) and **UP ARROW** (♠) buttons for three seconds. A P number ill displad.

Refer to Table 2.4 to find the parameter associated ith each P number. Use the **UP ARROW** (\uparrow) button or the **DOWN ARROW** (\downarrow) button to move from one parameter to the ne t. The display of cles through the P numbers sho n in Table 2.1 and Table 2.4. When our each P22, the ne t P number ill go back to P1.

When the parameter number \dot{l} ou ant to change is on the displar, press the **LEFT ARROW** (\leftarrow) button to displar the data assigned to that parameter. Press the **SET** button and the far right number on the displar starts flashing. If \dot{l} ou ant to change this number, press the **UP ARROW** (\uparrow) button or the **DOWN ARROW** (\downarrow) button. To skip the number ithout changing, press the **LEFT ARROW** (\leftarrow) button. When the number is correct, press the **SET** button. The numbers stop flashing and the control accepts the ne setting. If a beep sounds, the ne setting as not accepted. Refer to Table 2.4 for allo able values for that parameter.

To change or vie other parameters, press the **LEFT ARROW** (\leftarrow) button to have the displar sho P numbers. No use the **UP ARROW** (\uparrow) button or the do n arro (\downarrow) button to move to the parameter number ou ish to change.

To e it the Level II programming mode, simultaneously press and hold the **DOWN ARROW** (↓) and **UP ARROW** (↑) buttons for three seconds, or ait 30 seconds ithout pressing a button. The control starts alternating the display bet een Tank in Service, Flo Rate and Capacity.

Settings for all parameters can be ritten on the label provided ith the control. The label has an adhesive backing so it can be attached to the inside rear cover of this manual for future service reference.

Level II Programming

Parameter P6 is used by the control to calculate the Refill Time. Press **SET** button and enter a ne value. Refer to Table 2.2 for the correct value. Parameter P7 is used by the control to calculate the brine dra time. Press the **SET** button and enter a ne value. Refer to Table 2.2 for the correct value. The control calculates the brine dra time using this value and the salt amount. The brine dra time is added to the Rinse Time (P10) to determine the total Brine Dra /Slo Rinse Time.

This control does not use Parameter P8. No entr¹ is needed for this parameter.

Parameter P12 selects the units of measure. Be sure that this is set to the correct value before entering an data for Parameters P3, P4 or P5.

Parameter P13 selects the clock displar mode. If the 12-hour mode is selected, a PM indicator is used. If the 24-hour mode is selected, the PM indicator is not used.

Parameter P15 has four allo able values. Values 0 or 1 ill cause the control to ait for Parameter P2, time of da of regeneration, to begin the regeneration. Values 2 or 3 ill cause the control to start the regeneration as soon as the capacities e hausted.

When Parameter P15 selects a smart reserve t¹ pe, 0 or 2, Parameter P16 is used to calculate the initial seven average dail¹ ater usage values. The control multiplies the total capacit¹ b¹ the percentage entered for Parameter P16 and uses that value as the initial average dail¹ usage for each da¹ of the eek until ater usage establishes ne averages, refer to Reserve Options, page 15.

Parameter 17 must be programmed follo ing the appropriate programming table. Improper

Parameter 17 must be programmed follo ing the appropriate programming table. Improper $\sqrt{}$ regenerations ill occur if P17 is set to an other number.

Parameter P18 allo s the installer to lock the Salt Amount and Capacit values so the cannot be changed. When Parameter 18 is set to 1, those to settings can only be vie ed hen the control is in the Level II mode. The settings ill be skipped hen the control is in the Level I mode. When Parameter 18 is set to ero, the Salt Amount and Capacit can be vie ed and changed in either Level I or Level II.

Parameter P19 selects the flo sensor that is to be used ith the statem. The factor preset value is 1 for a 1-inch turbine. The range is 1 - 4. 1 = Autotrol 1-inch turbine, 2 = Autotrol 2-inch turbine, 3 = user programmable K-factor, 4 = user programmable pulse equivalent. The K-factors or pulse equivalents for individual meters should be supplied by the respective meter manufacturer.

Parameter P20 is programmed onl if P19 = 3 or 4. P20 is here the factor supplied K-factor or pulse equivalent number is programmed.

Parameter P21 allo s the user to tell the control ho long a signal must be present at the remote (r m)9.6(dd.3(t)-8s5(h)0.7(4(at)-980.8 320-23.9(t)-8s5(h))9.6(e²

Parameter P22. Special codes are entered at the factor to program all of the pertinent P locations for specific controls; Metric for e ample. This parameter should never be changed by the end user.

Electronic Time Clock Operation

Programming automatic regeneration frequenc¹:

The Electronic Time Clock has to regeneration options: Interval Regeneration and Day of Week Regeneration.

To initiate an automatic regeneration one or both of the options must be chosen. The si stem mai also be regenerated manualli bi pressing the Regeneration button for three seconds.

Interval Regeneration The Electronic Time Clock mar be programmed to regenerate in intervals of up to 30 dar s. This feature is Parameter P14 Calendar Override (see Table 2.4). E ample: If 5 is programmed into P14 then the sr stem ill regenerate ever five dar s at the time programmed into P2.

Day of Week Regeneration The Electronic Time Clock ma⁷ be programmed to regenerate on a specific da⁷ or on specific da⁷ s of the eek. The instructions for this option are found in Table 2.3 on page 15.

Application

The Performa Cv 962 Conditioner and the Performa Cv 962F Filter may be operated as a single, dual, or triple system.

Dual and Triplex Conditioners and Filters

The dual and triple s¹ stems require a different cam than the cam that is used in the single unit sⁱ stems. The also require an interconnecting lock out cable. This allo s the unit that is in regeneration or back ash to signal the other units and prevents them from starting a regeneration or back ash until the first unit is finished. Dual and triple units should be plumbed in parallel ith each other, In a multi-unit sⁱ stem the back, ash ater is supplied b^i_{J} the other unit or units in the s^i stem. In a dual filter s¹ stem consideration must be given that the unit in service is able to satisf service requirements and be able to supply sufficient back ash ater to the other filter hile it is in the back ash cⁱ cle. There is a selection guide, Table 4.6, in Section 4.0 to assist in qualifi ing the choice of a dual or triple si stem. This selection guide is based on media back ash requirements and tank diameter.

A parallel kit must be purchased for multi-unit operation. The kit numbers are:

Dual Parallel Conditioner P/N 1035923
Triple Parallel Conditioner P/N 1035925
Dual Parallel Filter P/N 1035924
Triple Parallel Filter P/N 1035926

Kits include parallel operation cams and the proper interconnect cable.

Manual Start Regeneration

To force the control to perform a regeneration, press the **REGEN** button. This button is located on the front of the control. When our press the **REGEN** button, the control performs a full regeneration of the conditioner.

If you press this button again more than one minute after regeneration begins, but before the regeneration is complete, a second regeneration will start when the first regeneration is finished. The displar ill free e and only sho the Regen Time Remaining as an indication that the second regeneration ill be performed. When the first regeneration is complete, the second one ill begin and the displar ill alternate bet een Flo and Regen Time Remaining.

Automatic Regeneration

Programming Day of the Week Regeneration/ Backwash

Enter Dar of the Week Regeneration/back ash programming brodepressing the **LEFT ARROW** (←) button and the **DOWN ARROW** (↓) button simultaneousl for 3 seconds, The dar s are sho in as d1, d2, d3, etc., on the displar. Select the dar s of the eek regeneration/back ash should occur. To activate that dar, change the Ø to a 1. The programming mode ill be e ited if no ker s are pressed for 30 seconds. If this feature is used in conjunction ith calendar override the calender override timer ill be reset at the end of this regeneration/back ash.

Table 2.3 - Day of Week Regeneration/Backwash

#	Description of Parameter	Set as required 0 = No - 1 = yes	Notes			
d1	Sunda	As required	0 = no da of eek regeneration 1 = back ash this da			
d2	Monda	As required	0 = no da of eek regeneration 1 = back ash this da			
d3	Tuesda	As required	0 = no da of eek regeneration 1 = back ash this da			
d4	Wednesda	As required	0 = no da of eek regeneration 1 = back ash this da			
d5	Thursda [†]	As required	0 = no da of eek regeneration 1 = back ash this da			
d6	Frida	As required	0 = no da of eek regeneration 1 = back ash this da			
d7	Saturda	As required	0 = no da of eek regeneration 1 = back ash this da			

Reserve Options

There are to t' pes of reserve options for this control: fi ed reserve and smart reserve (historical ater usage pattern). The are selected ith Parameter P15.

Fixed Reserve

When fi ed reserve is selected, the control multiplies the ma imum s stem capacit b the percent value set in Parameter P16 and uses the result as a reserve.

Smart Reserve (water usage pattern)

The other reserve option allo s the control to adjust the reserve/based upon the historical ater usage pattern of the s' stem. The control keeps track of the ater usage for each da' of the reek and uses that da' s average usage multiplied b' 1.2 as the reserve for that da'. Even da' at the Time of Regeneration, the control recalculates the da' s average ater usage. If less than 10% of a da' s average ater usage is used, the control ill not change the da' s average. If more than to ice the da' s average is used, the control uses the actual usage in the reserve calculation.

Since a ne installation has no histor of vater usage, the control multiplies the percent of capacit value set in Parameter P16 b the total s stem capacit to determine starting average for each da of the eek.

The factor, set value for P16 is/30 hich means that 30% of the total style stem capacit is used for the starting average for each da.

Program Parameter P15 is also used to select hether the control aits until the Time of Regeneration set in Parameter P2 to start a regeneration, or if the control should begin a regeneration immediatel hen the capacit remaining is less than the reserve.

2.3 Conditioner Programming Tables

Table 2.4 - Level II Programming Performa Cv 962 Parallel Multi Tank or Single Tank Conditioner

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P6	Refill controller	2-200	1	Selected from Table 2.2		This number tells the controller the rate of refill based on the refill control installed. Refill d ell time is calculated to refill the proper amount of ater into brine tank.
P7	Brine dra rate	2-200	1	Selected from Table 2.2		This number tells the controller the dra rate based on the injector si e. The d ell time in the dra position is then calculated.
P9	Back ash time	4-60	1	14*	Minutes	*Mar be adjusted for application

P10 Slo Ri1i6.9(is)3.1(1i35(ul)M8t-14.5(i(6.922(u)1-55(.)-468)-107(6.9(i-)58.4(S)5.62(6.9(i5.8(634.1(31.0606 0 TD0.019-0.00 T [(14)30.3(*)]TJ/40000 TD0.019-0.00 TD0.019

Go to Section 3.2 for detailed e planation of the programming parameters on this page.

Table 2.5 - Programming Performa Cv 962TC Electronic Time Clock Conditioner

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P1	Da ['] of Week and Time of Da [']	(1-7) 1:00-12:59 AM or PM Metric (1-7) 0:00-23:59	(1 da/) 1 Minute	Current Day and Time	Hour Minute	Range depends on value selected for P13. For da of eek SUN=1, MON=2, TUE=3, WED=4, THU=5, FRI=6, SAT=7,. THIS IS THE LEFT MOST DIGIT ON THE DISPLAY
P2	Time of dar to start regeneration	1:00-12:59 AM or PM 00:00-23:59		As required	Hour Minute	Range depends on value selected for P13
P3	As recommended			10		
P4	Salt amount	.5-125.0 .2-50.0	.5 .2	Selected from Table 2.2	Pounds Kilograms	
P5	Program as Recommended			10		
P6	Refill controller	2-200	1	Selected from Table 2.2		This number tells the controller the rate of refill based on the refill control installed. Refill d ell time is calculated to refill the proper amount of ater into brine tank.
P7	Brine dra rate	2-200	1	Selected from Table 2.2		This number tells the controller the dra rate based on the injector si e. The s ell time in the dra posițion is then calculated.
P9	Back ash time	4-60	1	14*	Minutes	*Mar, be adjusted for application
P10	Slo Rinse time	7-125	1	40*	Minutes	*Ma [†] be adjusted for application. This time does not include the calculated brine dra time.
P11	Fast Rinse time	2-60	1	4*	Minutes	*Ma be adjusted for application
P12	Units of measure	0-1	1	0		0 = US, 1 = Metric
P13	Clock mode	0-1	1	0	1	0 = 12 hour clock, $1 = 24$ hour clock
P14	Interval Regeneration Calendar override	0-30	1	0	Da ¹ s bet een regeneration	0 = no interval chosen - *Ma [/] be adjusted for application.
P15	Does not appl ⁷ for Timeclock operation			0		
P16	Does not apply for Timeclock operation			30		
P17	Operation t [/] pe	3-4	1	6		6 = Single 962TC
P18	Salt Change Lock out	0-1	1	0		0 = none, 1 = Salt/Capacit change locked out
P19	Does not apple for Timeclock operation					
P20	Does not appl ⁾ for Timeclock operation					
P21	Remote Regeneration S itch Dela	0-254	1	60	Seconds	Time remote s itch must be active to start a regeneration
P22	Factor Use Onl - DO NOT CHANGE			99		-

Go to Section 3.2 for detailed e planation of the programming parameters on this page.

3.0 Performa Cv Filter Valve and Controls, 962F, 962FTC, 942F

3.1 Programming and Application

This section covers all aspects of programming the control.

Table 3.1 - Programming Performa Cv 962F Three Cycle Filter

_			1		T	T
Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P1	Da of eek and time of da	(1-7) 1:00-12:59 AM or PM Metric (1-7) 0:00-23:59	(1 dar) 1 Minute	Current Day and Time	Hour Minute	Range depends on value selected for P13. For da' of eek SUN=1, MON=2, TUE=3, WED=4, THU=5, FRI=6, SAT=7,. THIS IS THE LEFT MOST DIGIT ON THE DISPLAY
P2	Time of dar to start back ash	1:00-12:59 AM or PM 00:00-23:59		As required	Hour Minute	Range depends on value selected for P13
P3	Program as recommended			10 100	U.S. Metric	
P4	Program as recommended			0.5		,
P5	Filter capacit			As required	U.S. Metric	Divide the volumetric capacit, (gallons) of the filter b, 100 and enter this number into P5. Divide the volumetric capacit, (cubic meters) b, 10 and enter this number into P5.
P6	Program as recommended			200		
P7	Program as recommended			200		
P9	Back ash time	7-60	1	14*	Minutes	*Ma be adjusted for application.
P10	Program as recommended			8		
P11	Fast Rinse time	9-60	1	9*	Minutes	*Ma be adjusted for application.
P12	Units of measure	0-1	1	0		0 = US, 1 = Metric 0 = 12 hour clock,
P13	Clock mode	0-1	1	0		1 = 24 hour clock
P14	Interval Regeneration	0-30	1	0	Da [√] s	0 = no interval chosen - *Mar be adjusted for application
P15	Reserve T [/] pe	0-3	1	0	For a detailed e planation go to E planation of Parameter Values P2 on page 24.	0 = Smart Reserve, 1 = Fi ed Reserve, 2 = Smart Reserve ith Immediate Regeneration, 3 = Fi ed Reserve ith Immediate Regeneration.
P16	Fi ed reserve percentage,	0-70	1	30		This number is used to establish initial Dail. Average.
P17	Operation to pe	0-7	1	4		4 = Filter Performa Cv
P18	Salt Change Lock out	0-1	1	0		0 = none, 1 = Salt/Capacit change locked out
P19	Flo Sensor Select	1-4	1	1		1 = 1 Autotrol Turbine, 3 = User Defined K-factor, 2 = 2 Autotrol Turbine, 4 = User Defined Pulse Equivalent
P20	K-factor or Pulse Equivalent	0.01-255.0	0.01	0.01		Number used for Meter K-factor or Pulse Equivalent.
P21	Remote Regeneration S itch/Dela	0-254	1	60	Seconds	Time remote s itch must be active to start a back ash
P22	Factor Use Onl - DO NOT CHANGE			99		

Go to Section 2.2 for detailed e planation of the programming parameters on this page.

Table 3.2 - Programming Performa Cv 962F Five Cycle Filter

Parameter Description Range of Minimum Program Units of Values Increment Value

Go to Section 2.2 for detailed e planation of the programming parameters on this page.

Table 3.3 - Programming Performa Cv 962 TC <u>Electronic Time Clock Filter</u>

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P1	Day of eek and time of day	(1-7) 1:00-12:59 AM or PM Metric (1-7) 0:00-23:59	(1 da [/]) 1 Minute	Current Day and Time	Hour Minute	Range depends on value selected for P13. For dar of eek SUN=1, MON=2, TUE=3,

Go to Section 2.2 for detailed e planation of the programming parameters on this page.

Electronic Time Clock Operation

To initiate an automatic back ash one or both of the follo ing options must be chosen. The strem may be back ashed manually by pressing the Back ash button for three seconds.

Programming automatic regeneration frequenc7:

The Electronic Time Clock has to regeneration options: Interval Regeneration and Day of Week Back ash.

Interval Backwash The Electronic Time Clock may be programmed to regenerate at intervals up to 30 days. This feature is also kno n as Calendar Override. It is located at P14. E ample: If 5 is programmed/into P14 then the system ill back ash every five days at the time programmed into P2.

Day of Week Backwash The Electronic Time Clock may be programmed to back ash on a specific day or specific day s of the eek. The instruction for this option is found in Table 2.3 on page 17.

Application

The Performa Cv 962 Conditioner and the Performa Cv 962F Filter may be operated as a single, dual, or triple so stem.

Dual and Triplex Conditioners and Filters

The dual and triple s' stems require a different cam than the cam that is used in the single unit s' stems. The also require an interconnecting lock out cable. This allo s the unit that is in regeneration or back ash to signal the other units and prevents them from starting a regeneration or back ash until the first unit is finished. Dual and triple units should be plumbed in parallel ith each other. In a multi-unit s' stem the back, ash ater is supplied b' the other unit or units in the s' stem. In a

3.2 Mechanical

Series 942F Mechanical Control

The Series 942F mechanical control provides mechanical timeclock function for filter applications.

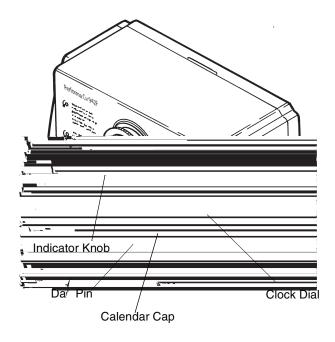


Figure 3.1

3.2.1 Settings

Setting the Time of Da¹, the Da¹ s of Back ash and performing manual back ashing ith the 942F controls.

Setting the Time of Day

Rotate the Clock Dial **clockwise** until the pointer indicates the correct time of dar. With the time of dar set, the conditioner ill back ash at appro imatel 2:00 a.m. If it is desired to have the unit back ash at an earlier or later time, simply offset the current time of dar accordingly. For e ample, to have the unit back ash at 4:00 a.m., set the Clock Dial 2 hours later than the actual current time of dar.

Note: Do not rotate the Calendar Cap by hand. The Clock Dial inde es the Calendar Cap dail. To manuall inde the Calendar Cap, rotate the Clock Dial clockwise one complete turn for ever dai to be inde ed. Dai pins should be in the out ard position during Clock Dial rotation to prevent an undesired back ash. Reset dai pins hen completed.

Setting the Days of Backwash

Setting the da¹ s that the conditioner ill back ash is accomplished in to simple steps:

- 1. Pull all of the da pins out ard.
- 2. Push in the da¹ pin(s) for the da¹ (s) on hich a back ash is desired.

NOTE: The NEXT DAY pin is noted on the control face. Pushing this pin ill insure a back ash the ne t da' at appro imatel 2:00 a.m. since the Calendar Cap progresses in a clock ise direction, pushing the da' pin immediatel follo ing the NEXT DAY pin counterclock ise ill insure a back ash occurs the follo ing da' at appro imatel 2:00 a.m. This progression is noted on the control face as FUTURE DAYS.

Manual Backwash

E gessive ater usage or other service related issues may create the need to manually back ash the filter. This function is performed by rotating the Indicator Knob **COUNTERCLOCKWISE** to the START position. Once in this position, the filter ill begin a back ash ithin a fe minutes. The normal schedule, established ith the pushed in day pins, ill not be disrupted by a manual back ash.

24 Hour Clock

The Performa Cv Series 942F control utili es a 24 hour clock dial. This is to pically referred to as Military Time. The hours of the day bet een 12:00 a.m. (midnight) and 12:00 p.m. (noon) are designated on the clock dial by the numbers 1 through 12, ith 1 being 1:00 a.m. The hours of the day bet een 12:00 p.m. (noon) and 12:00 a.m. (midnight) are designated on the clock dial by the numbers 13 through 24, ith 13 being 1:00 p.m. Be sure to set the correct time of day accordingly.

Adjusting the Backwash Setting

The Back ash Dial (Figure 3.2) controls the back ash time. With the Indicator Knob in the BACKWASH COMPLETE position, rotate the Back ash Dial counterclock ise at least one full turn to cancel out the current setting. A light clicking sound ill be replaced by a heavier clicking sound hen the previous setting is cancelled. Once the heavier clicking is heard, the ne setting may be set by rotating the Back ash Dial to the desired setting. The numbers on the Back ash Dial represent MINUTES of back ash time.

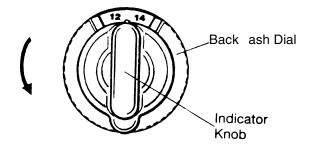


Figure 3.2 Back ash Complete

Table 3.4 - Cycle Times for 942F Control

Cycle	Time (Minutes)
Back ash	8 - 30
Purge	9

3.3 Explanation of Parameter Values for the 962 Single and Parallel Tank Controls

This section contains a detailed e planation of the programming parameters in the 962 electronic control.

Number

Description of Program Values Explanation

Number	Description of Program Values	Explanation
P5 page 12	Capacit of unit	Enter the capacit ¹ of the unit here, in kilograins (kilograms). For e ample, a 3 ft ³ unit ith a resin capacit ¹ of 25,000 grains (1620 grams) per ft ³ , enter 75 here. (25,000 grains/ft ³) (3 ft ³) = 75,000 grains = 75 kilograins. [(1620 grams/ft ³) (3 ft ³) = 4860 grams = 4.86 kilograms]. Note: 15 lb/cu ft salting ¹ ields 30,000 grains/cu ft resin 10 lb/cu ft salting ¹ ields 25,000 grains/cu ft resin 6 lb/cu ft salting ¹ ields 20,000 grains/cu ft/resin Reduced salting ¹ ields a reduced capacit ¹ 1 kilograin (1000 grains) = 0.0648 kilograms (64.8 grams)
P6 page 12	Refill control	Enter value from Table 2.1 - Suggested Settings on page 12 of manual. This value is the refill flo rate times 100, rounded to the ne t hole number. For e ample, on a 16-inch tank, the refill control has a flo rate of 1.3 gpm. Enter 130 (1.3 gpm 100 = 130).
P7 page 12	Brine dra rate	Enter value from Table 2.1 - Suggested Settings on page 12 of manual. This is the injector dra rate times 100, rounded to the ne t hole number. For e ample, on a 16-inch tank, the injector has a dra rate of 0.8 gpm. Enter 80 (0.8 gpm 100 = 80).
P8	Not used	P8 is reserved for future use.
P9	Back ash time	Self e planator. Generall, 5 to 15 minutes or until ater runs clear or specific ater conservation needs are met.
P10	Slo rinse	Time, in minutes, to achieve adequate slo rinse volume for resin t' pe used. Resin manufacturers recommend one to to and one half bed volumes of slo rinse ater. The required amount of time is calculated using the injector performance curves provided in Section 4.0 of this manual.
		For e ample, assuming 4 cubic feet of resin and t o bed volumes of slo rinse ater for a 16 65, 50 psi inlet pressure, program 43 minutes in Parameter P10. (4 cubic feet) (7.5 gallons/cubic foot) 2 (bed volumes) = 60 gallons of slo rinse ater. A Q injector is recommended for a 16-inch tank. From the Q injector performance chart the nominal slo rinse rate is 1.4 gpm. 60 gallons divided bird 1.4 gallons per minute equals 42.8 minutes. Round up to 43 minutes and enter in P10.
P11	Fast rinse	Time, in minutes, to achieve adequate fast rinse volume for resin t^i pe used. For e ample, for standard softening resin (lonac C-249), fast rinse at 30 gallons (0.11 m³) per cubic foot of resin. A unit ith 3 ft³ of resin ill require 90 gallons (0.34 m³) of ater to obtain the resin manufacturer's recommended fast rinse. (30 gal/ ft³ 3 ft³) = 90 gallons. (0.11 m³/ ft³ 3 ft³ = 0.34 m³). The fast rinse flo rate is controlled b' the drain line flo control. For this e ample, assume a 5 gpm (1.14 m³/hr) drain line flo control. Enter 18 minutes in P10. (90 gallons/5 gpm) = 18 minutes (0.34 m³/1.14 m³/hr = 0.3 hr/ 60 min = 18 minutes).
P12	Units of measure	Self e planator, Enter 0 for U.S., enter 1 for metric.
P13	Clock mode	Self e planator. Enter 0 for 12-hour clock, enter 1 for 24-hour clock.
P14	Calendar override	0 = No calendar override. 1 - 30 = Ma imum number of da s bet een regeneration/back ash.
P15	Reserve to pe Immediate or delatoregeneration	See P2. Not used in Alternating mode.
P16 ***	Fi ed Reserve capacit	If P15 is set at 1 or 3, enter the fi ed reserve capacit (in gallons) (m³) that the unit ill look for as e plained in sections P2 and P15 above. Not used in Alternating mode.
P17	Operation t pe	Self e planator . 3 = Single or parallel Conditioner or Tank; 4 = Single or Parallel Filter.

Number	Description of Program Values	Explanation
P18	Salt/capacit/ lockout	Allo s for the lock out of P4 and P5 so that NO unauthori ed changes to the programmed values can be made.
P19	Flo Sensor Select	This parameter is used to select the flo sensor that is to be used ith the street. The factor of preset value is 1 for a 1-inch turbine. The range is 1 - 4. 1 = Autotrol 1-inch turbine, 2 = Autotrol 2-inch turbine, 3 = user programmable K-factor, 4 = user programmable pulse equivalent. The respective meter manufacturer should supply the K-factors or pulse equivalents for individual meters.
P20	K-factor or pulse equivalent	The range is 000.01 to 255.00 in 0.01 steps. Ho this number is used is defined b' the values stored in P12 (units of measure) and P19 (flo sensor select). P12 is used to define gallons or liters (0 = gallons, 1 = liters). P19 is used to define K-factor or pulse equivalent (3 = K-factor, 4 = pulse equivalent). K-factor is defined as pulses per gallon or pulses per liter. Signet and Sea-Flo are to flo sensor manufacturers that publish a K-factor. The control can no use an' flo sensor as long as the programmed K-factor is correct. The pulse equivalent is defined as gallons or liters per pulse. The control ill register 5 gallons of flo for ever' pulse if P12 = 0, P19 = 4 and P20 = 5.00. Badger Meter is one manufacturer that uses a pulse equivalent. The control ill not sho flo rate if P19 = 4 (pulse equivalent). This is because pulses are accumulated over 10 seconds and flo rate is display ed in gallons per minute. The control ill alternate bet een time of day and capacity remaining or regeneration time remaining during normal operation.
P21	Remote regeneration/ backy ash s itch delar	This parameter is used to program the length of signal time required to initiate a regeneration/back ash using a differential pressure s itch or remote start button/contact. The range is 1 to 254 seconds in 1-second steps. The default is 60 seconds. A counter starts hen there is a closed dr' contact (no voltage) to this input. A regeneration/back ash ill start hen the contacts remain closed for the programmed time. The counter ill reset to ero hen the contacts open for at least 0.02 seconds. The remote regeneration input cannot be used to perform a double manual regeneration. The remote regeneration input is ignored during a regeneration/back ash.
P22	Factor [/] use onl [/]	DO NOT CHANGE


^{*} The 962 controller functions in either a 12-hour or 24-hour clock mode. Programming P13 (clock mode) before P1 or P2 ill eliminate an confusion hen setting these parameters.

*** The calculated gallon amount loaded into the dail registers (L7 through L13) at START-UP, uses this percentage of capacity. E ample: 90,000 grains, in P5 10 grains in P3, 90,000 / 10 = 9,000 gallon capacity, 9,000 .3 (30% in P16) = 2700 gallons, hich is loaded into L7 through L13, the dail averages. For this e ample, the smart reserve at START-UP, ould be 2700 gallon 1.2 (120% of the dail average) = 3240 gallon. This dail average ill change as actual ater usage information is gathered.

^{**} The 962 controller functions in either U.S. or metric units. Programming P12 (units of measure) before P3 or P4 ill eliminate an confusion hen setting these parameters.


4.0 Performa Cv Performance Charts and Graphs


4.1 General Specification

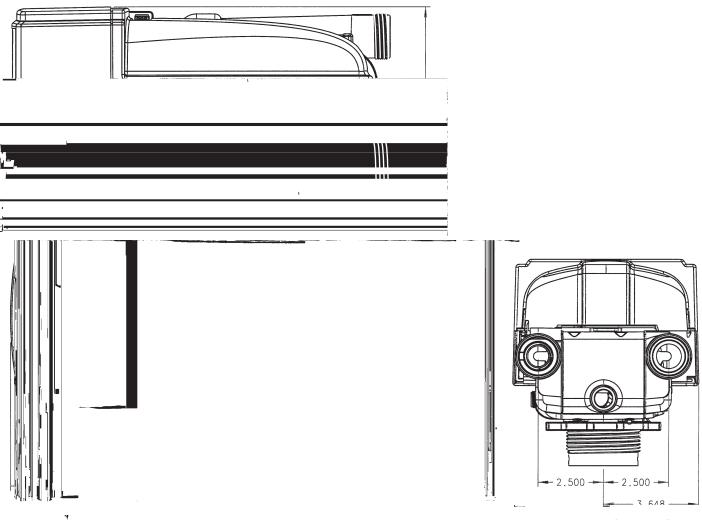



H [/] drostatic Test Pressure
Working Pressure
Standard Electrical Rating
942F: 7 da ⁷ or 12 da ⁷ /24 hour 50 H 12 V transformer, 60 H 120 Vac or 12 V transformer
Electrical Cord (standard rating)
Pressure Tank Thread
Riser Pipe Diameter Required
Riser Pipe Length
Standard Connection
Optional Connections
3/4-inch BSPT, 1-inch BSPT, 1-inch NPT brass pipe adapters
3/4-inch, 1-inch, 1-1/4-inch, 25-mm CPVC tube adapters
Brine Line Connection
Drain Line Connection
Optional B [/] pass Valve Rotating handles, full 1-inch porting, reinforced Plastic
Control Module, Tank Adapter
Rubber Goods
Program Clock (Timer) 942F: Available in 7- to 12-da, English, German, French, Italian, Spanish, Japanese 962, 962F, 962TC, 962FTC: Available in English, German, French, Italian, Spanish, Japanese
Brine Refill Control
E ternal Back ash Controllers


4.2 Injector Curves

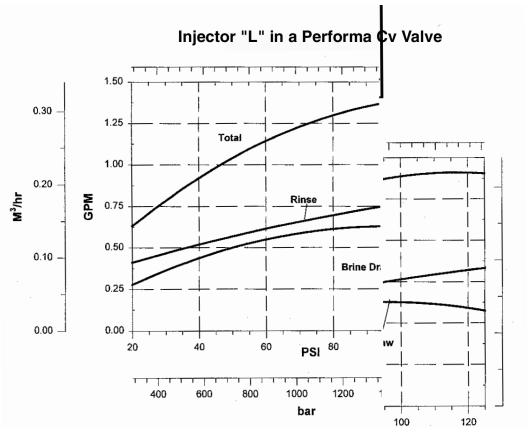

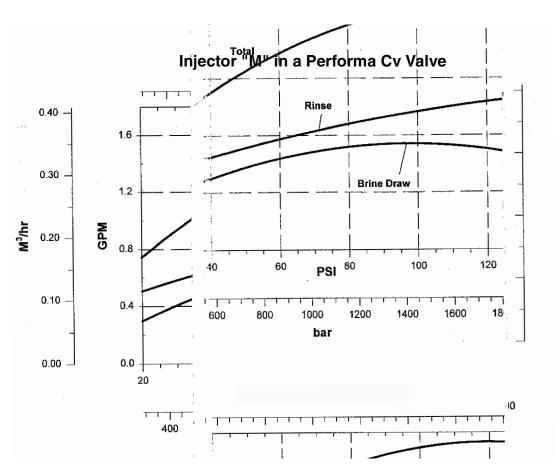

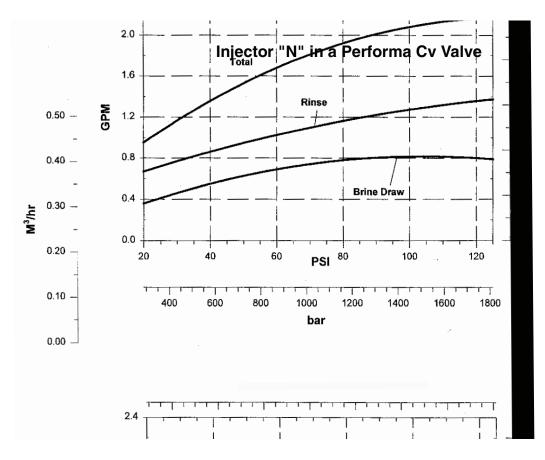

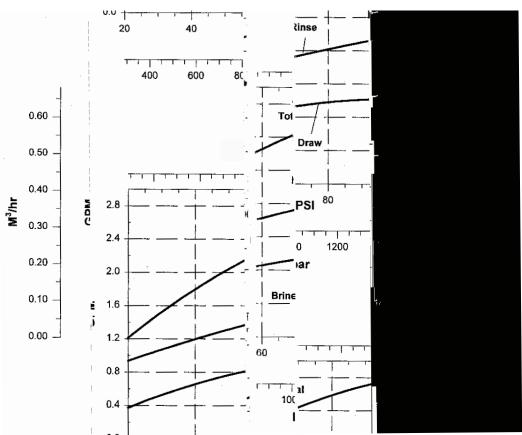

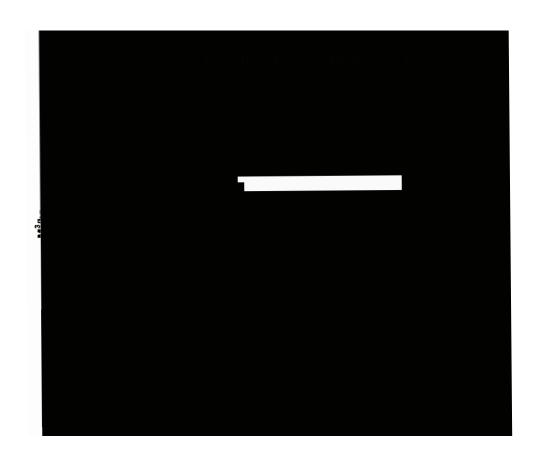

4.3 Performa Cv Conditioner Performance Data

Table 4.1 - Performa Cv Injector Performance Chart

			Inject	ors L - R F	low Rate C	harts (gpn	n)			
PSI	SI L M	N		Q		R				
	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse
20	0.26	0.4	0.3	0.5	0.4	0.65	0.4	0.9	0.45	1.2
30	0.3	0.45	0.4	0.55	0.45	0.75	0.5	0.95	0.5	1.3
60	0.5	0.6	0.6	0.8	0.75	1	0.82	1.4	0.9	1.75
80	0.6	0.65	0.7	0.85	0.8	1.1	0.9	1.6	1	2
100	0.6	0.76	0.7	0.9	0.8	1.6	0.95	1.8	1.1	2.2
			Inject	ors L - R F	low Rate C	harts (Lpn	n)			
Bar		L	ı	VI		N	(Q	ĺ	R
	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse
1.4	0.98	1.5	1.1	1.9	1.5	2.5	1.5	3.4	1.7	4.5
2.1	1.1	1.7	1.5	2.1	1.7	2.8	1.9	3.6	1.9	4.9
4.2	1.9	2.3	2.3	6	2.8	3.8	3.1	5.3	3.4	6.6
5.6	2.3	2.5	2.6	3.2	3	4.2	3.4	6	3.8	7.6
7	2.3	2.9	2.6	3.4	3	4.9	3.6	6.8	4.2	8.3

Table 4.2 - Service and Backwash Flow Performance Data

F	Flow vs Pressure Drop (gpm)			low vs Pressure Dro	op (Lpm)			
PSI	PSI Service (Cv 6.5) Backwash (Cv 4.0)		Service (Cv 6.5) Backwash (Cv 4.0) Ba		Bar	Service (Cv 6.5)	Backwash Cv 4.0)	
5	15	9	0.35	56	34			
10	20	13	0.7	76	49			
15	25	16	1	95	61			
20	29	18	1.4	109	68			
25	32	20	1.7	121	76			
30	35	22	2.1	132	83			

Table 4.3 - Recommended Drain Flow Controls (Backwash Anion and Cation Resin @ 55° F (12.7°C) Water Temperature

Tank Diameter Inches (mm)	Bed Area sq. ft.	Anion Resin @ 3 gpm/sq ft (m ³ h/sq ft)	Cation Resin @ 5 gpm/ sq ft (m ³ h/sq ft)
14 (35.6)	1.02	3 (.7)	5 (1.1)
16 (40.6)	1.38	4 (.9)	7 (1.5)
18 (45.7)	1.76	5 (1.1)	8 (1.8)
21 (53.3)	2.4	7 (1.5)	12 (2.7)

Table 4.4 - Performa Filter

Pressure Loss vs Flow (gpm)				
PSI Service (Cv 6.5) Backwash (Cv 5.6				
5	15	11		
10	20	16		
15	25	19		
20	29	22		
25	32	25		
30	35	27		
	Pressure Loss vs Flow (Lp	m)		
Bar	Service (Kv 5.6)	Backwash (Kv 5.8)		
0.35	56	42		
0.7	76	61		
1	95	72		
1.4	109	83		
1.7	121	95		
2.1	132	102		

Table 4.5 - Typical Backwash Flow Requirements for Various Filter Medias (based on 55°F (12.7°C) water temperature)

		GAC/CARBON FILT	TER-AG, CALCITE		
			GREENSAND		
			ВІ	RM	
				SAND, MI	ULTI-MEDIA
	Bed Area sq. ft.			10 gpm/sq ft (Lpm/sq ft)	12 gpm/sq ft (Lpm/sq ft)
14 (35.6)	1.02	8 (30)	10 (38)	12 (45)	15 (57)
16 (40.6)	1.38	11 (42)	13 (49)	16 (61)	20 (76)
18 (45.7)	1.76	14 (53)	17 (64)	21 (79)	*26 (98)
21 (53.3)	2.4	19 (72)	24 (91)	*29 (98)	
24 (60.9)	3.14	25 (95)			

^{*}Mar e ceed 25 psi or 1.72 bar pressure drop.

Table 4.6 - Performa Cv Filter Sizing Selection Guide for Dual Unit Filters.

		GAC/CARBON FILT	TER-AG, CALCITE		
			В	IRM	
				SAND, MULTI-MEDIA	
Tank Dia. inches (mm)	Bed Area sq. ft.	8 gpm/sq ft (Lpm/sq ft)	10 gpm/sq ft (Lpm/sq ft)	12 gpm/sq ft (Lpm/sq ft)	15 gpm/sq ft (Lpm/sq ft)
14 (35.6)	1.02	8 (30)	10 (38)	12 (45)	NR
16 (40.6)	1.38	11 (42)	13 (49)	NR	NR
18 (45.7)	1.76	*14 (53)	NR	NR	NR
21 (53.3)	2.4	NR	NR	NR	NR

^{*} Mar e ceed 25 psi or 1.72 bar pressure drop during back ash of second unit.

NR = Not Recommended. A flo control on the service outlet of each valve ma be required to insure proper back ash volume to back ashing unit.

:

5.3 Removing the Valve Assembly for Servicing

- 1. Unplug the po er cord.
- 2. Shut off ater suppl or put b pass valve(s) into b pass position.
- 3. Remove cover and ith scre driver, relieve tank pressure b pushing open valve No. 7 (rear flapper) on control as sho n (Figure 5.2).

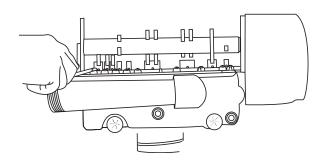


Figure ¹

- 4. When used ith a globe detach the inlet, outlet, the valve. If using the 1 remove valve from b' r removing the brine ar
- 5. Unscre (counterclor from tank.
- 6. To replace the contr procedure.

5.4 Removing the

Complete the follo ing control for servicing:

- 1. Unplug the all-mou
- 2. Shut off the ater su, into b pass position.
- 3. Remove the rear cove provided on the cover, the cover and remove to

Figure 5.3

4. Relieve s stem pressure b opening the Back ash Drain Valve (the seventh valve back from the control) ith a scre driver, Figure 5.4.




Figure 5.6

- 6. Disconnect the turbine probe from the turbine assembl .
- 7. Lift the control off the valve, Figure 5.7. To replace the control, reverse the above procedure. Note that the camshaft needs to be positioned correctly before it can be inserted into the back of the control. There is a locating arro on the camshaft. Position the arro on the top of the shaft and slide the camshaft into the control. Push up on the end of the camshaft, furthest from the timer, snapping it into place.


Figure 5.7

5.5 Identifi



3 Brine/Slow Rinse Position

4 Fast Rinse Position

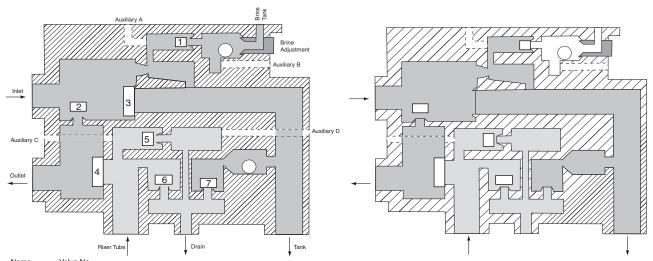

 Name
 Valve No.

 Brine
 1 - Open

 By-Pass
 2 - Open

 Inlet
 3 - Closed

 Outlet
 4 - Closed


 2nd Tank Top
 5 - Open

 Purge
 6 - Open


 Backwash
 7 - Closed

5.8 Performa Cv Filter Flow Diagrams

1 Backwash Position

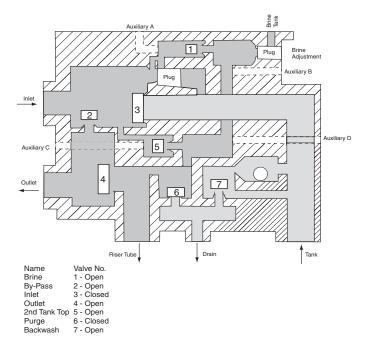

2 Fast Rinse Position

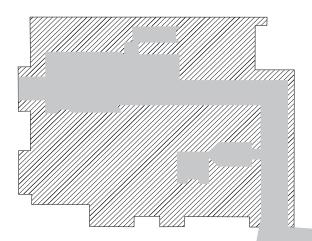

5.9 Troubleshooting

The technolog upon hich the Autotrol Performa control valve is based is ell established and proven in service over man ears. Ho ever, should a problem or question arise regarding the operation of the settem, the control can be serviced easile. For parts mentioned, refer to e ploded vie s in the **Replacement Parts** section of this manual.

IMPORTANT: Service procedures that require the ater pressure to be removed from the s['] stem are marked ith a ! after the possible cause. To remove ater pressure from the s['] stem, put the b['] pass valve or three-valve b['] pass into the b['] pass position and open the back ash drain valve (the seventh valve back from the control) ith a scre driver. Restore s['] stem ater pressure hen the service ork is completed.

Valve Troubleshooting

8. Hard ater leakage during

Va	ive froubleshooting						
Problem		Possible Cause			Solution		
1.	Control ill not dra brine.	a.	Lo ater pressure.	a.	Set pump to maintain 30 psi at conditioner.		
		b.	Restricted drain line.	b.	Remove restriction.		
		C.	Injector plugged!	c.	Clean injector and screen.		
		d.	Injector defective!	d.	Replace injector.		
		e.	Valve (2 and/or 4) not closed.	e.	Remove foreign matter from disc and check disc for closing b ['] pushing in on stem. Replace if needed.		
		f.	Damaged injector O-ring.	f.	Replace injector O-ring.		
2.	Brine tank overflo .	a.	Brine valve (1) being held open.	a.	Manuall operate valve stem to flush a a obstruction.		
		b.	Uncontrolled brine refill flo rate!	b.	Remove variable salt controller to clean.		
		C.	Valve (3 or 4) not closed during brine dra causing refill.	C.	Flush out foreign matter b holding disc open and manuall operating valve stem.		
		d.	Air leak in brine line.	d.	Check all connections in brine line for leaks. Refer to instructions.		
	S ⁷ stem using more or less salt than salt control is set for.	a.	Inaccurate setting.	a.	Correct setting.		
		b.	Foreign matter in controller causing incorrect flo rates!	b.	Remove variable salt controller and flush out foreign matter. Manuall position control to brine dra to clean controller (after so doing, position control to purge to remove brine from tank).		
		C.	Defective controller.	C.	Replace controller.		
4. lı	Intermittent or irregular brine	a.	Lo ater pressure.	a.	Set pump to maintain 30 psi at conditioner.		
	dra .	b.	Defective injector!	b.	Replace both injector and injector cap.		
	No conditioned ater after	a.	Unit did not regenerate.	a.	Check for po er.		
	regeneration.	b.	No salt in brine tank.	b.	Add salt.		
		C.	Plugged injector !	C.	Clean injector. Flush ith ater.		
6.	Control baçk ashes at	a.	Incorrect back ash controller used.	a.	Replace ith correct si e controller.		
е	e cessivel [/] lo or high rate.	b.	Foreign matter affecting controller operation !	b.	Remove controller and ball. Flush ith ater.		
(Flo ing or dripping ater at drain or brine line after regeneration.	a.	Drain valve (6 or 7) or brine valve (1) held open b foreign matter or particle.	a.	Manuall operate valve stem to flush a a obstruction.		
		b.	Valve stem return spring on top plate eak.	b.	Replace spring.		

962 Control Troubleshooting

Alarms

The Model 962 continuously monitors itself and sounds an alarm if it detects something rong. The alarm is a beep that is on for one second and then off for nine seconds.


When the alarm sounds, the displates shows the letters Err ith a number from 1 to 4. The table belocalists the Err numbers, a description of each error, the cause of the error, and the solutions. To silence the alarm, press and button on the control. If the error still exists, the control ill go back to the alarm condition after 30 seconds.

Model 960 Alarms

Indication	Description	Cause	, , Solution
Err1	Electronics Failure	Control settings need	Press an ke to load default values. Refer
		reprogramming.	to Programming the Model 960 Control.
Err2	Improper start of	Valve camshaft has been	Press an ke to silence the alarm. (Note:
	regeneration (limit s itch	manuall/ rotated during a	Alarm automaticall clears at TIME OF
	closed hen it should be	regeneration.	REGEN .)
	open).	Valve camshaft has been	The control ill turn the motor on and drive
		manuall/ rotated out of	the camshaft to the proper location.
		regeneration complete	
		position.	
		Faulty motor.	Replace the control.
		Fault/ motor drive.	Replace the control.
		Fault s itch.	Replace the control.
Err3	Improper finish of	Valve camshaft has been	The control ill turn the motor on and drive
	regeneration (limit s itch	manuall/ rotated out of	the camshaft to the proper location.
	open hen it should be	regeneration complete	
	closed).	position.	
		Fault/ motor.	Replace the control.
		Fault/ motor drive.	Replace the control.
		Fault s itch.	Replace the control.
Err4	Improper control settings	One or more settings out of	Hardness: Adjust range: 3 to 250.
	(one or more settings out of	the allo able range.	Capacit : Adjust range: 0.1 to 140.0.
	the allo able range).		Refill control: Adjust range: 1 to 99.
			Brine dra value: Adjust range per
			Table 4.1.

Problem	Possible Cause	Solution	
Capacit displa sta sat 9999 even through there is ater usage.	a. Total s ⁷ stem capacit ⁷ as calculated to be a value greater than 9999.	a. As the , ater usage continues, the remaining capacit ill drop belo 9999 and then other values ill be sho n.	
Timer beeps hen left arro button is pressed.	Button is onl ⁷ active in the programming mode.	a. Refer to the Programming section.	
Timer does not respond to REGEN button. /	Button is not active in the programming mode.	a. Refer to the Regeneration section.	
4. Timer does not displatime of	a. Transformer is unplugged.	a. Connect po er.	
da [/] .	 b. No electric po er at outlet. 	b. Repair outlet or use orking outlet.	
	c. Defective transformer.	c. Replace transformer.	
J	d. Defective circuit board.	d. Replace control.	
5. Timer does not displa correct	a. Outlet operated b ⁷ a s itch.	a. Use outlet not controlled b ⁷ s itch.	
time of dat.	b. Po er outages.	b. Reset Time of Da ⁷ .	

Problem	Possible Cause		Solution		
6. No ater flo displa hen	a.	B pass valve in b pass position.	a.	Shift b pass valve into service position.	
ater is flo ing (colon does not blink).	b.	Meter probe disconnected or not full connected to meter housing.	b.	Full insert probe into meter housing.	
	C.	Restricted meter turbine rotation due to foreign material in meter!	C.	Remove meter housing, free up turbine and flush, ith clean ater. Turbine should spin freel. If not, refer to the Water Meter Maintenance section.	
	d.	Defective meter probe.	d.	Replace control.	
,	e.	Defective circuit board.	e.	Replace control.	
7. Control displatis is fro en at Regen Time Remaining.	a.	Back to back regenerations ere requested.	a.	Refer to the Manual Regeneration section.	
8. Control regenerates at the	a.	Po er outages.	a.	Reset time of dat, to correct time of dat,	
rong time of da ⁷ .	b.	Time of da set incorrecti.	b.	Reset time of dat to correct time of dat.	
	C.	Time of regeneration set incorrecti.	c.	Reset time of regeneration.	
9. Timer stalled in regeneration	a.	Motor not operating.	a.	Replace control.	
c ⁷ cle.	b.	Motor runs back ards.	b.	Replace control.	
	C.	No electric po er at outlet.	C.	Repair outlet or use orking outlet.	
	d.	Incorrect voltage or frequenc (H).	d.	Replace timer and/or transformer ith one of correct voltage and frequenc (H).	
	e.	Broken gear.	e.	Replace control.	
	f.	Defective s itch.	f.	Replace control.	
	g.	Air leak in brine connections (pressure locked flapper).	g.	Check all junction points and make appropriate corrections.	
	h.	Binding of camshaft.	h.	Remove foreign object obstruction from valve discs or camshaft.	
	i.	Water pressure greater than 125 psi during regeneration.	i.	Install pressure regulator to reduce pressure.	
	j.	Defective circuit board.	j.	Replace control.	
10. Continuous regeneration.	a.	Broken projection on drive gear.	a.	Replace control.	
Camshaft does not stop at the end of regeneration.	b.	Defective s itch.	b.	Replace control.	
11. Control doeş not regenerate	a.	Transformer unplugged.	a.	Connect po er.	
automaticall [/] or hen REGEN	b.	No electric po er at outlet.	b.	Repair outlet or use orking outlet.	
button is depressed.	C.	Defective motor.	C.	Replace control.	
	d.	Broken gear.	d.	Replace control.	
	e.	Binding in gear train.	e.	Replace control.	
	f.	Defective s itch.	f.	Replace control.	
12. Control does not regenerate automaticall but does	utomaticall, but does to iter		a.	Refer to item 5 in this table.	
regenerate hen REGEN button is depressed.	b.	Incorrect hardness and capacit [/] settings.	b.	Set ne control values. Refer to the Programming section.	
	C.	Defective circuit board.	C.	Replace control.	
13. Run out of soft ater bet een regenerations.	a.	Improper regeneration.	a.	Repeat regeneration making certain that correct salt dosage is used.	
	b.	Fouled resin bed.	b.	Use resin cleaner.	
	C.	Incorrect salt setting.	C.	Set salt control to proper level. Refer to the Programming section in this manual.	
	d.	Incorrect hardness or capacit ⁷ settings.	d.	Set to correct values. Refer to the Programming section in this manual.	
	e.	Water hardness has increased.	e.	Set to ne value. Refer to the Programming section in this manual.	
	f.	Restricted meter turbine rotation due to foreign material in meter housing!	f.	Remove meter housing, free up turbine, and flushy ith clean ater. Turbine should spin freel, if not, replace meter.	
	g.	E cessive ater usage belo 1/5 gallon per minute.	g.	Repair leak plumbing and/or fi tures.	

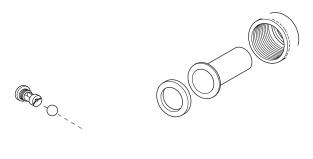

6.3 Performa Cv Controls

